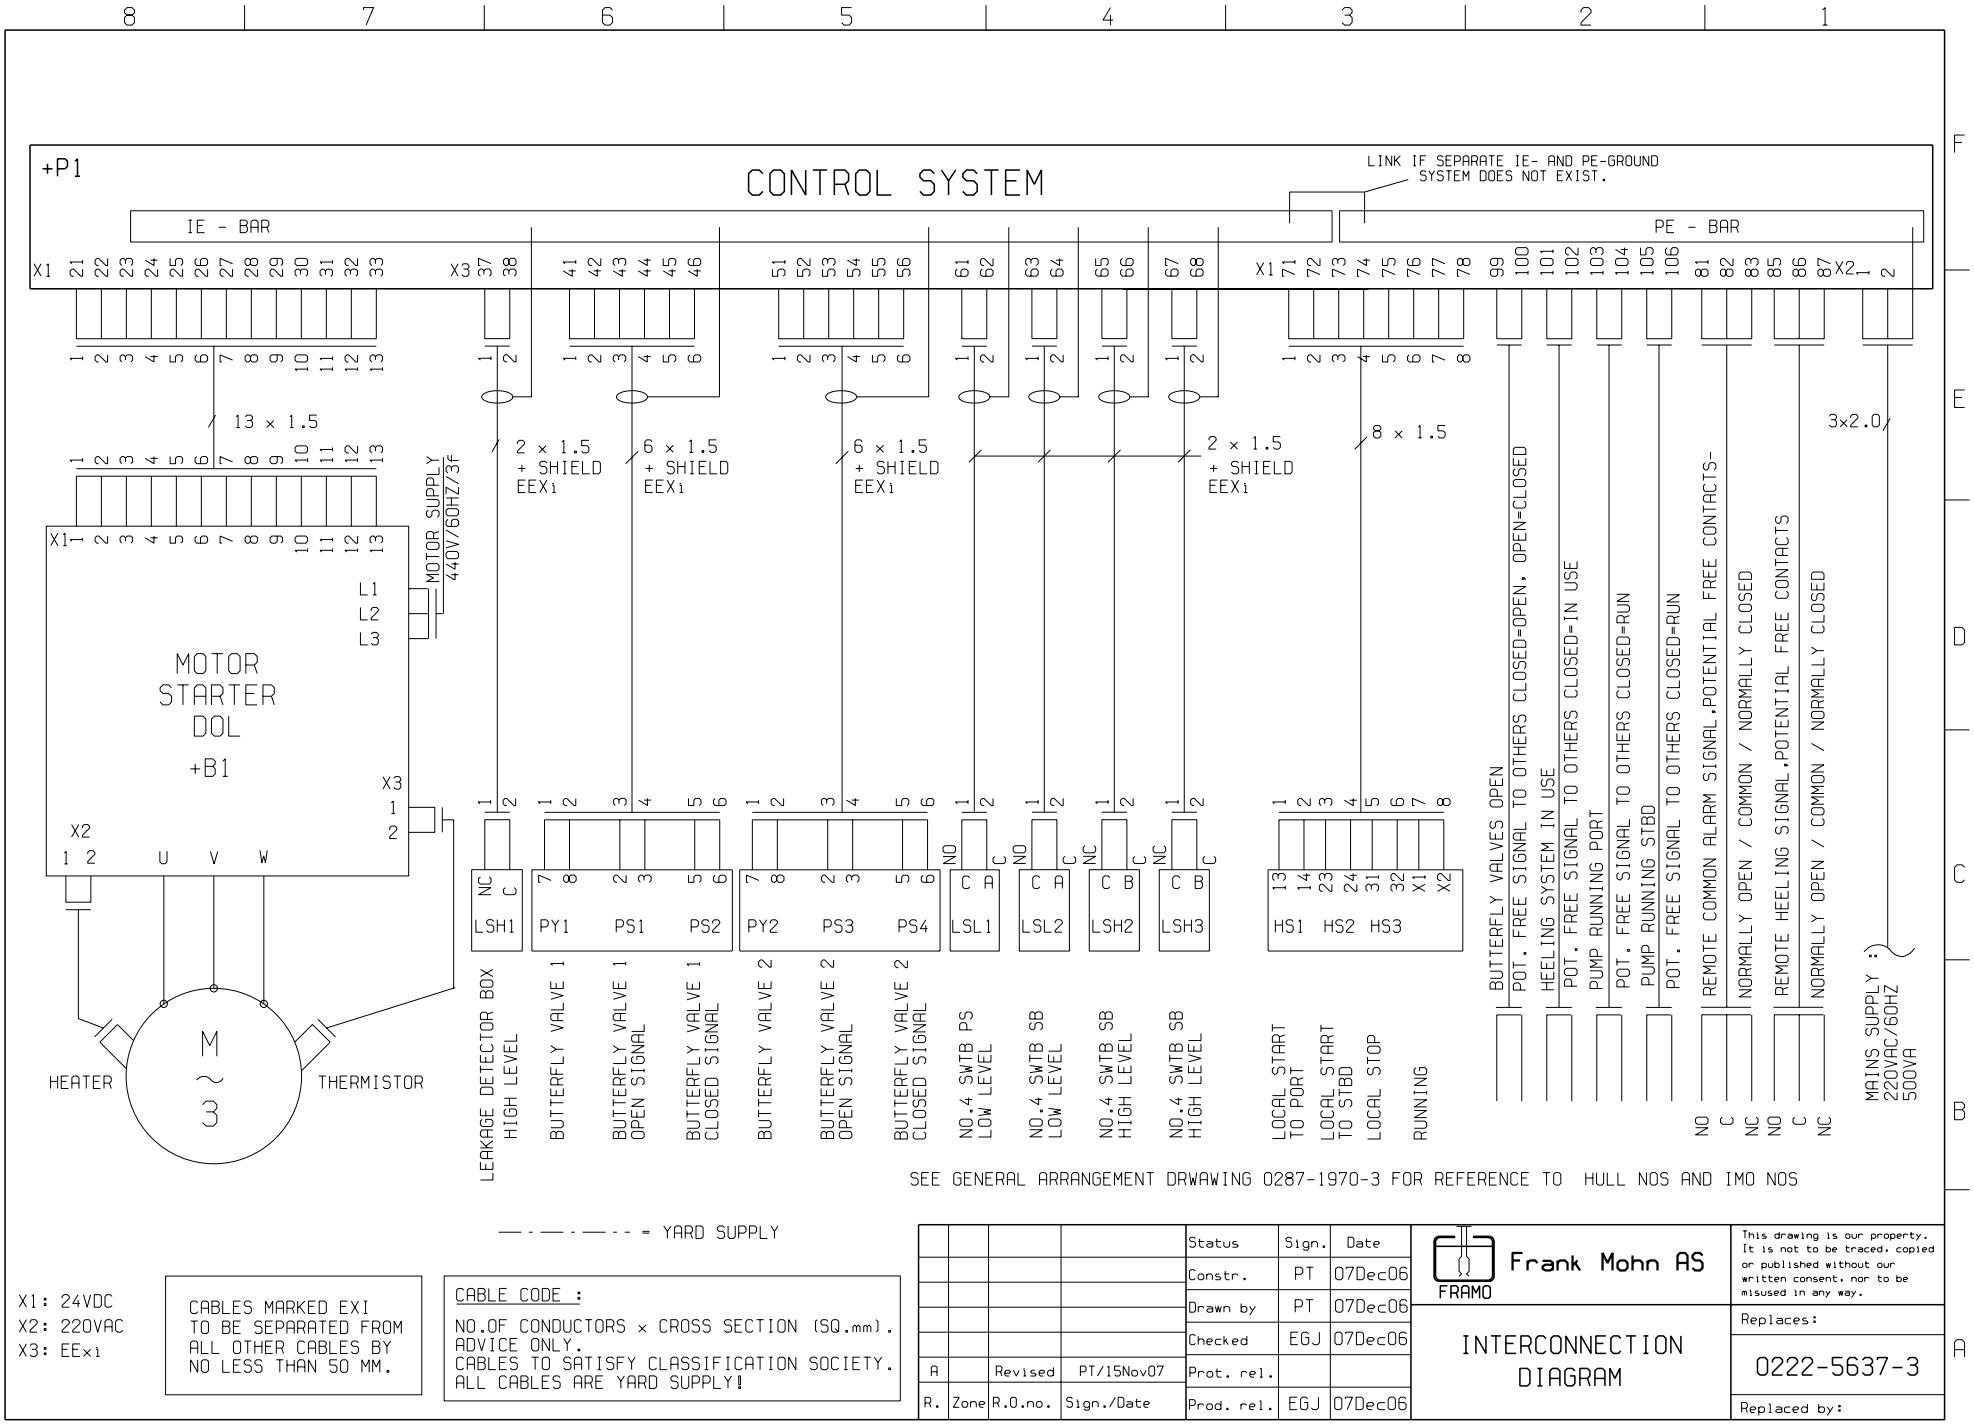

SEE GENERAL ARRANGEMENT DRWAWING 0287-1970-3 FOR REFERENCE TO HULL NOS AND IMO NOS

—·—·—·— = YARD SUPPLY

X1: 24VDC
X2: 220VAC
X3: EEXi

CABLES MARKED EXI TO BE SEPARATED FROM ALL OTHER CABLES BY NO LESS THAN 50 MM.

CABLE CODE :

NO.OF CONDUCTORS x CROSS SECTION (SQ.mm).
ADVICE ONLY.
CABLES TO SATISFY CLASSIFICATION SOCIETY.
ALL CABLES ARE YARD SUPPLY!

R.	Zone	R.O.no.	Sign./Date
A		Revised	PT/15Nov07

Status	Sign.	Date
Constr.	PT	07Dec06
Drawn by	PT	07Dec06
Checked	EGJ	07Dec06
Prot. rel.		
Prod. rel.	EGJ	07Dec06

FRAMO Frank Mohn AS

INTERCONNECTION DIAGRAM

This drawing is our property. It is not to be traced, copied or published without our written consent, nor to be misused in any way.

Replaces:

0222-5637-3

Replaced by: